
1978 Buss 2 Bucket R3

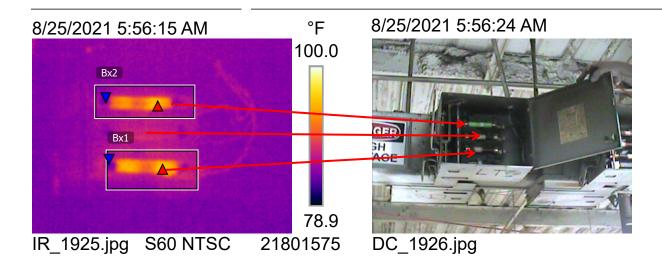

Measurements

Max	95.8 °F
Min	82.4 °F
Average	87.7 °F
Max	95.3 °F
Min	82.6 °F
Average	87.2 °F
	0.95
	49 °F
	Min Average Max Min

Infrared data indicatesthat Phase A and C is operating at a higher temperature than Phase B . This issue needs futher investigation. Could be that the machine is only using 2 phases not 3 phases . Check voltage and Amp draw , replace fuses and clean fuse clips as needed.