



## AC Inspection as Found

Arauco-Malvern MDF (10298)

1275 Willamette Rd  
Malvern, AR 72104

FolderID: 101974  
FormID: 18127311

### AC Inspection - Rev. 2

Location: LR MOTORSHOP

Serial Number:

Description: 75 HP TECO TEFC

Hi-Speed Job Number: 101974

Manufacturer: TECO Westinghouse

Serial Number: CXP7127305008

HP/kW: 75 (HP)

RPM: 1775 (RPM)

Frame: 365T

Voltage: 230 / 460

Current: 170.2 / 85.1

Phase: Three

Hz: 60 (Hz)

Service Factor: 1.15

Enclosure: TEFC

# of Leads: 12

J-box Included: None

Coupling/Sheave: None

Date Received: 10/11/2023

Bearing RTDs: No

Stator RTDs: No

Repair Stage: Final

Rewind: No

Shaft Machined Fit Repairs  
Required: No

Bearing Housing Machined  
Fit Repairs Required: Yes

Heaters: No

Winding Type : Random Wound

Bearing Type: Rolling Element

Priorities Found: 2 - High 6 - Good

### Overall Condition



1. Report Date

2. Nameplate Picture

P37



3. Photos of all six sides of the machine.

P45











4. Describe the Overall Condition of the Equipment as Received  
*Serviceable*

#### Initial Mechanical/Electrical



- |                                    |              |
|------------------------------------|--------------|
| 5. Does Shaft Turn Freely?         | (Yes) Yes    |
| 6. Does Shaft Have Visible Damage? | (No) No      |
| 7. Assembled Shaft Runout          | 0.004 Inches |
| 8. Assembled Shaft End Play        | 0 inches     |
| 9. Air Gap Variation <10%          | Na           |
| 10. Lead Condition                 |              |

P56



- |                 |           |
|-----------------|-----------|
| 11. Lead Length | 12 Inches |
|-----------------|-----------|

Hi-Speed Industrial Service disclaims all warranties, both express and implied, relating to the information, reports, opinions and analysis disclosed to the Customer by Hi-Speed. Hi-Speed shall not be liable for any errors or omissions, or any losses, injury or damages arising from the use of such information, reports, opinions and analysis by the Customer.

## 12. Lead Numbers

1-12

1-12) 2-10) 3-11). 4-7, 5-8, 6-9

## 13. Frame Condition

pass

## 14. Fan Condition

(P) Pass

P109



## 15. Broken or Missing Components

missing connection box.

## Initial Electrical Inspection



## 16. Insulation Resistance/Megger

Megohms

P8




## 17. Winding Resistance


P20

1-2

1-3

2-3

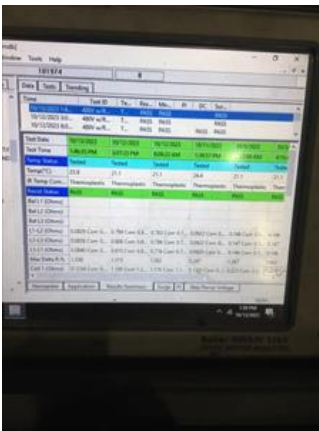

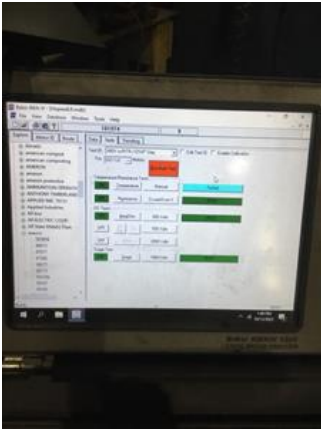

19. Number of Stator Slots

48

20. Stator Condition

pass

21. Stator Thermistors/Ohms

na

22. Stator Overloads/Ohms

**Mechanical Inspection**

23. Drive End Bearing Brand

FAG

P15



24. Drive End Bearing Number-

6313 2Z. C3

P28



25. Drive End Bearing Qty.

1

26. Drive End Bearing Type

(Ball) Ball Bearing

27. Drive End Lubrication Type

(Grease) Grease Lubricated

Hi-Speed Industrial Service disclaims all warranties, both express and implied, relating to the information, reports, opinions and analysis disclosed to the Customer by Hi-Speed. Hi-Speed shall not be liable for any errors or omissions, or any losses, injury or damages arising from the use of such information, reports, opinions and analysis by the Customer.



28. Drive End Bearing Insulation or Grounding Device?

Aegis

P64



29. Drive End Wavy Washer/Snap-Ring Other Retention Device?

locking cap

P75



30. Drive End Bearing Condition

replace

P80



31. Opposite Drive End Bearing Brand

Fag

P92





32. Opposite Drive End Bearing Number-

6213 2Z C3

P97



33. Opposite Drive End Bearing Qty.

1

34. Opposite Drive End Bearing Type

(Ball) Ball Bearing

35. Opposite Drive End Lubrication Type

(Grease) Grease Lubricated

36. Opposite Drive End Bearing Insulation or Grounding Device?

none

37. Opposite Drive End Wavy Washer/Snap-Ring Other Retention Device?

locking cap

P115



38. Opposite Drive End Bearing Condition

replace

39. Drive End Seal

none

40. Opposite Drive End Seal

none

## Rotor Inspection



Hi-Speed Industrial Service disclaims all warranties, both express and implied, relating to the information, reports, opinions and analysis disclosed to the Customer by Hi-Speed. Hi-Speed shall not be liable for any errors or omissions, or any losses, injury or damages arising from the use of such information, reports, opinions and analysis by the Customer.



- |   |                  |
|---|------------------|
| 42. Growler Test                                    | (Pass) Pass      |
| 43. Number of Rotor Bars                            | 40               |
| 44. Rotor Condition                                 | pass             |
| 45. List the Parts needed for the Repair Below      |                  |
| 46. Signature of Technician that Disassembled Motor | Terrence Holland |

**Mechanical Fits- Rotor**

- |                  |              |
|------------------|--------------|
| 47. Shaft Runout | 0.003 inches |
|------------------|--------------|

- |                  |  |
|------------------|--|
| 48. Rotor Runout |  |
|------------------|--|

Drive End Bearing Fit

Rotor Body

Opposite Drive End Bearing

Na

- |   |  |
|---|--|
| 49. Coupling Fit Closest to Bearing Housing |  |
|---|--|

0 Degrees

90 Degrees

120 Degrees

Na

- |  |  |
|--|--|
| 50. Coupling Fit Closest to the end of the Shaft |  |
|--|--|

0 Degrees

60 Degrees

120 Degrees

Na

- |                                 |  |
|---------------------------------|--|
| 51. Drive End Bearing Shaft Fit |  |
|---------------------------------|--|

0 Degrees

60 Degrees

120 Degrees

2.5594

2.5594

2.5594

- |   |          |
|---|----------|
| 52. Drive End Bearing Shaft Fit Condition | (P) Pass |
|---|----------|

- |  |  |
|--|--|
| 53. Opposite Drive End Bearing Shaft Fit |  |
|--|--|

0 Degrees

60 Degrees

120 Degrees

2.5594

2.5595

2.5594

- |  |          |
|--|----------|
| 54. Opposite Drive End Bearing Shaft Fit Condition | (P) Pass |
|--|----------|

## 55. Shaft Air Seal Fits

Drive End Air Seal

Opposite Drive End Air Seal

Na

## Mechanical Fits- Bearing Housings



## 56. Drive End - Endbell Bearing Fit

P2

0 Degrees

60 Degrees

120 Degrees

5.5133

5.5134

5.5133



## 57. Drive End - Endbell Bearing Fit Condition

(F) Fail

## 58. Opposite Drive End - Endbell Bearing Fit

0 Degrees

60 Degrees

120 Degrees

4.7256

4.7257

4.7257

## 59. Opposite Drive End - Endbell Bearing Fit Condition

(F) Fail

P38



## 60. Bearing Cap Condition

Drive End Bearing Cap  
pass

Opposite Drive End Bearing Cap  
pass



## 61. End Bell Air Seal Fits

Drive End Air Seal

Opposite Drive End Air Seal

Na

## 62. List Machine Work Needed Below

*Both end bell housing fits pitted and fretted.*

## 63. Technician

Terrence Holland

### Dynamic Balance Report

## 64. Rotor Weight and Balance Grade

Rotor Weight

Balance Grade

## 65. Initial Balance Readings

Drive End

Opposite Drive End

## 66. Final Balance Readings

Drive End

Opposite Drive End

## 67. Technician

### Root Cause of Failure

## 68. Failure locations

*Housing fits bad and bearing grease was contaminated in both bearings. Recommend replacing aegis ring on d.e bearing cap. Aegis shaft dia 2.9470*

## 69. Root cause of failure

*Housing fits bad and bearing grease contaminated.*

### Mechanical Fits- Bearing Housings - Post Repair



70.	Drive End - Endbell Bearing Fit Post Repair		
	0 Degrees	60 Degrees	120 Degrees
71.	Opposite Drive End - Endbell Bearing Fit Post Repair		
	0 Degrees	60 Degrees	120 Degrees
72.	Bearing Cap Condition Post Repair		
	Drive End Bearing Cap	Opposite Drive End Bearing Cap	
73.	End Bell Air Seal Fits Post Repair		
	Drive End Air Seal	Opposite Drive End Air Seal	
74.	End Bell Repair Sign-off		
Assembly			
75.	QC Check All Parts for Cleanliness Prior to Assembly		
76.	Photograph All Major Components prior to assembly		
77.	Final Insulation Resistance Test		
78.	Assembled Shaft Endplay		
79.	Assembled Shaft Runout		
80.	Test Run Voltage		
	Volts	Volts	Volts
81.	Test Run Amperage		
	Amps	Amps	Amps
82.	Drive End Vibration Readings - Inches Per Second		
	Horizontal	Vertical	Axial
83.	Opposite Drive End Vibration Readings - Inches Per Second		
	Horizontal	Vertical	Axial
84.	Ambient Temperature - Fahrenheit		
85.	Drive End Bearing Temps - Fahrenheit		
	5 Minutes	10 Minutes	15 Minutes
86.	Opposite Drive End Bearing Temps - Fahrenheit		
	5 Minutes	10 Minutes	15 Minutes
87.	Document Final Condition with Pictures after paint		
88.	Final Pics and QC Review		