

### **Job Information**

Job #:	142990				Date:	August 6, 2020
Priority:	_	Authorized OT:	No	Authorized by:		

## **Customer Information**

Name: Southern Steel Motor#:

### **Name Plate Information**

Manufacturer:	R&M	Enclosure :	Totally Enclosed Fan Cooled	Horsepower/kW:	11kw
Serial#:		Model#:		Service Factor:	
Frame:		Rated RPM:	3250/440	Rated Voltage:	480
Phase:	3	Rated Amps:	20/10	Cycles:	60

Special design: No

VEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



### **AC Electrical Inspection**

Megs at reassem	oly:	Good	Surge at reassembly:	Good	Hi-	pot reassembly:	Good
Winding Resista	nce Inc	oming					
	Phases	s A to B	Phases B to C	Phases C to A		Resistive imbala	nce
Outgoing	15.60	2	15.617	15.609		0.1	
Test Run InspectionDateAugust 5, 2020							

I have merged this motor and verified that all electrical tests are complete! Yes

#### **Power Supply**

	Phase A	Phase B	Phase C
No Load Voltage	445	442	443
No Load Current	8	7	7

### **Temperatures: (Degrees Fahrenheit)**

### Test run ball-bearing motors for 15 minutes.

### Test run sleeve bearing motors for 60 minutes.

Temperature rise at the end of test run should be less than 2° every five minutes.

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



### MILLINGTON, TN LITTLE ROCK, AR


# **Test Run Inspection (Continued)**

#### Ambient Temp:

TIME	DE	Degree Change	ODE	Degree Change
START:				
5 MIN:				
10 MIN:				
15 MIN:				
20 MIN:				
25 MIN:				
30 MIN:				
35 MIN:				
40 MIN:				
45 MIN:				
50 MIN:				
55 MIN:				
60 MIN:				



### **Test Run Inspection (Continued)**

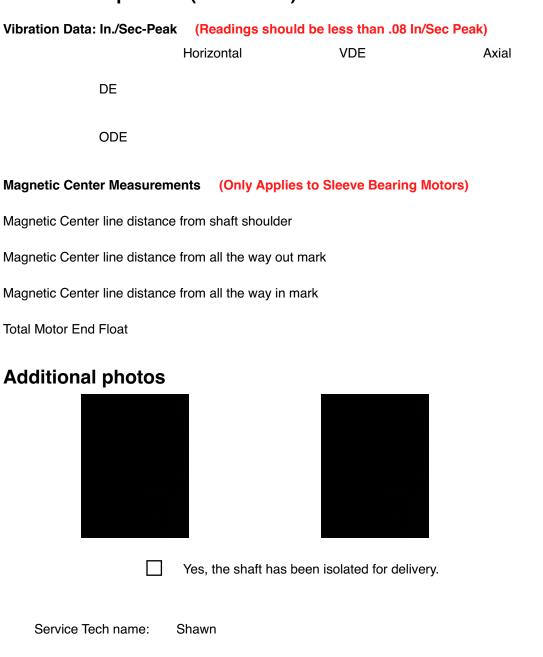

Service Tech signature:



WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301