

Job Information

Job #:	96774				Date:	April 30, 2020
Priority:	-	Authorized OT:	No	Authorized by:		

Customer Information

Name:

Motor#:

Name Plate Information

Manufacturer:	Telkoku usa	Enclosure :	Open Drop Proof (ODP)	Horsepower/kW:	8.3
Serial#:	PJ0813A	Model#:	R42-316F4AM-060 8	Service Factor:	
Frame:		Rated RPM:		Rated Voltage:	460
Phase:	3	Rated Amps:	12	Cycles:	60

Special design: No

VEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



AC Electrical Inspection

Megs at reassembly:	Good	Surge at reassembl	y: Good	Н	i-pot reassembly:	Good	
Winding Resistance Incoming							
Ph	ases A to B	Phases B to C	Phases C to	λ	Resistive imbala	ince	
Outgoing							
Test Run InspectionDateApril 30, 2020							
— I have merged this motor and verified that all electrical tests are complete!							
Power Supply	Phase	A F	Phase B	Pha	se C		
No Load Voltage							
No Load Current							
Temperatures: (Degrees Fahrenheit)							
Test run ball-bearing motors for 15 minutes.							

Test run sleeve bearing motors for 60 minutes.

Temperature rise at the end of test run should be less than 2° every five minutes.

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



MILLINGTON, TN LITTLE ROCK, AR


Test Run Inspection (Continued)

Ambient Temp:

TIME	DE	Degree Change	ODE	Degree Change
START:				
5 MIN:				
10 MIN:				
15 MIN:				
20 MIN:				
25 MIN:				
30 MIN:				
35 MIN:				
40 MIN:				
45 MIN:				
50 MIN:				
55 MIN:				
60 MIN:				



Test Run Inspection (Continued)

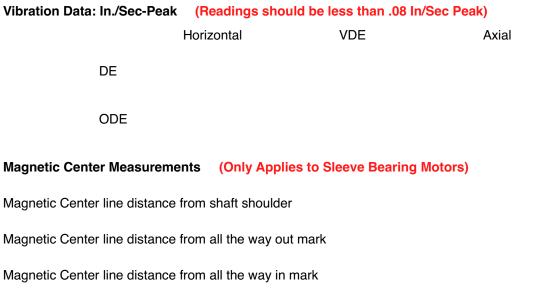

Total Motor End Float

Additional photos










Yes, the shaft has been isolated for delivery.

Service Tech name:

Terrence Holland

Service Tech signature:

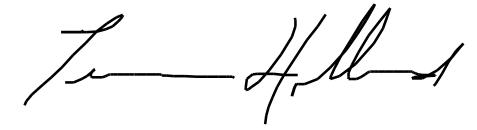

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301