

Job Information

Job #:	141352				Date:	December 12, 2019
Priority:	_	Authorized OT:	No	Authorized by:		

Customer Information

Name:	Process and power		Reason:	
Contact:		Motor#:		PO#:
Application:	_	Special notes:		

Name Plate Information

Manufacturer:	Reliance	Enclosure :	Open Drop Proof (ODP)	Enclosure Type image
Serial#:		Model#:		
Service Factor:		Frame:		
Horsepower/kW:	150	Rated RPM:	1775	
Rated Amps:	179	Rated Voltage:	230/460	
Phase:	3	Cycles:	60	
Special design:	No			

Nameplate

DE

ODE

F1

F2











WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



Mechanical Inspection

Inspect bolt holes and fasteners. Validate correct fasteners.

Does the shaft turn freely?:	Yes	Contaminant(s):	Dirt
Shaft rotation:	_	Contaminant(s) Amt:	Gallon
Shaft grounding device present?:	No	Contaminant Image:	
Type of grounding device: Shaft runout(TIR-Inbound):	.003		
Bearings DE:	Worn	Bearings DE make:	FAG
Insulated:	No	Bearing DE Size:	NU316E
Bearings ODE:	Worn	Bearings ODE make:	FAG
Bearing Type:	Ball	Bearing ODE Size:	6316C3
Bearings Retainer:	Yes	Thermal Protection:	Yes
Retainer condition:	_	Thermal Protection Type:	_
Bearing Type Image	Bearing Make Image	Bearing Retainer Image	Thermal Protect





ection

Not Available

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



Mechanical Inspection (Continued)

Lubrication Type:	Grease	Thermal Protection device DE:	-
Lubrication brand inbound:	Mobile Polyrex EM	Thermal Protection device ODE:	_
Lubrication brand outbound:	Mobile Polyrex EM		
Grease Amt DE:	Full	Grease Cond. DE:	New
Grease Amt ODE:	Full	Grease Cond. ODE:	New
Seals DE type:	Slinger	Seals Image:	Not
Seals DE size:			Available
Seals DE (inbound) condition :			
Seals ODE type:	Slinger	Seals Image 2:	Not
Seals ODE size:			Available
Seals ODE (inbound) condition :			
Shaft damage cause:	None	Shaft Image:	



VEST TENNESSE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



MILLINGTON, TN LITTLE ROCK, AR


Mechanical Inspection (Continued)

Brg. Image:



Bushings/sleeves image:



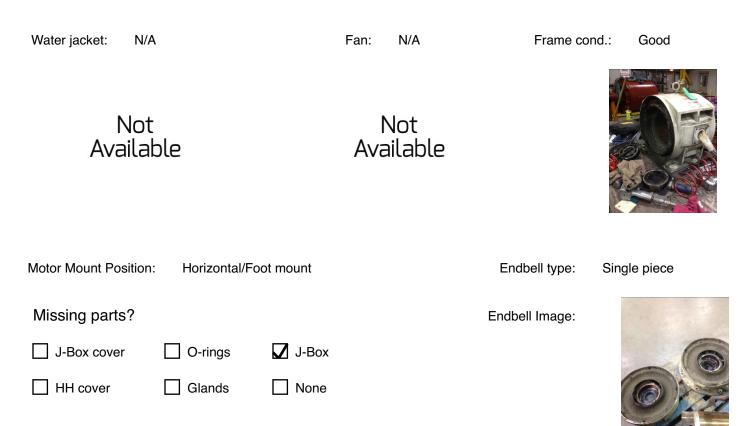

Other missing parts

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



Mechanical Inspection (Continued)

Air Gap Meaurements (N/A on Single Piece Endbell)			Does Air Gap Meet Customer or EASA spec(<10% variation)?
	DE @ 0	ODE @ 0	_
	DE @ 90	ODE @ 90	
	DE @ 180	ODE @ 180	
	DE @ 270	ODE @ 270	

AC Electrical Inspection


Number of leads:	9	Terminal Markings:			
Length of leads:	5ft	REF: NEMA Stds. MG 1-2009, Rev. 1-2010, 2.41-Terminal Markings Identified By Color:			
Size of leads:	4	1-Blue 2-White 3-Orange	5-Black 6-No color assigned 7-No color assigned	P1-No color assigned P2-Brown	
Lead condition:	Good	4-Yellow	8-Red		
Lug type:		Connections As Re	ceived:		
Lug Condition:	Good		Terminal	Lugs	
Lug size:			Not ailable		
Lug Attachment:	_	AV	ailadig	S	

WEST TENNESSE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



MILLINGTON, TN LITTLE ROCK, AR

AC Electrical Inspection (Continued)

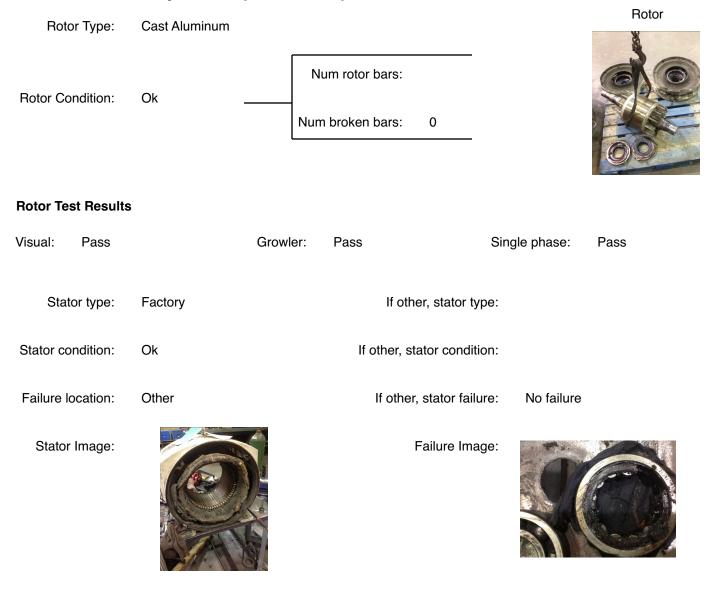

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



- · ·

AC Electrical Inspection (Continued)

Winding color:	Still has color	Winding	g image	Winding Therma	al Protection:	No	
Winding condition :	Solid				N	lot	
Winding Thermal Protection DE:	_					Available	
Winding Thermal Protection ODE:	_						
Stator test results:	Salvageable						
Megs incoming: Good	t	Surge incoming:	Good	Hi-pot in	ncoming: G	lood	
Winding Resistance In	coming						
Phase	es A to B	Phases B to C	Phase	es C to A	Resistive imb	balance	
Incoming							
Leads/jumpe	ers: Ok		Lead jur	nper Image. :			
If other, leads/jumpe	ers:						

VEST TENNESSE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



Conclusion

Component Failure

Bearings

Cause of Failure

Worn roller bearing on drive end .Bearing was over greased

Comments

Service Tech name: Terry

Service Tech signature:



 $\langle \alpha \rangle$

WEST TENNESSEE

7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301