

## **Job Information**

Job #:	96411				Date:	January 6, 2020
Priority:	-	Authorized OT:	No	Authorized by:		

### **Customer Information**

Name:	3M Company		Reason:	Reason:		
Contact:		Motor#:	PO#:			
Application:	_	Special notes:	Job # entered wrong should be 96411			

## **Name Plate Information**

Manufacturer:	Siemens	Enclosure :	Totally Enclosed Fan Cooled	Enclosure Type image
Serial#:	E0610150EU7	Model#:	Fair Cooled	
Service Factor:	1.15	Frame:	365T	
Horsepower/kW:	50	Rated RPM:	1185	4750
Rated Amps:	131/65.5	Rated Voltage:	230/460	
Phase:	3	Cycles:	60	
Special design:	No			

Nameplate

DE

ODE

F1

F2

Тор



WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



## **Mechanical Inspection**

#### Inspect bolt holes and fasteners. Validate correct fasteners.

Does the shaft turn freely?:	Yes	Contaminant(s):	Grease
Shaft rotation:	Bi-directional	Contaminant(s) Amt:	Other
Shaft grounding device present?:	No	Contaminant Image:	
Type of grounding device:			
Shaft runout(TIR-Inbound):			

Bearings DE:	Worn	Bearings DE make:	SKF
Insulated:	No	Bearing DE Size:	6314
Bearings ODE:	Fell Apart	Bearings ODE make:	Other
Bearing Type:	Ball	Bearing ODE Size:	6210
Bearings Retainer:	No	Thermal Protection:	No
Retainer condition:	_	Thermal Protection Type:	_

#### Bearing Type Image



Bearing Make Image

Bearing Retainer Image

**Thermal Protection** 

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301





# **Mechanical Inspection (Continued)**

Lubrication Type:	Grease	Thermal Protection device DE:	_
Lubrication brand inbound:	Unknown	Thermal Protection device ODE:	_
Lubrication brand outbound:	Unknown		
Grease Amt DE:	Full	Grease Cond. DE:	Hard
Grease Amt ODE:	Full	Grease Cond. ODE:	Hard
Seals DE type:	N/A		
Seals DE size:			
Seals DE (inbound) condition :			
Seals ODE type:	N/A		
Seals ODE size:			
Seals ODE (inbound) condition			
Shaft damage cause:	None	Shaft Image:	



VEST TENNESSE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



# **Mechanical Inspection (Continued)**

Brg. Image:



Water jacket:	N/A		Fan:	Broken	Frame cor	nd.:	Good
Motor Mount Pos	ition: Horizontal/F	oot mount			Endbell type:	Singl	e piece
Missing parts	?			Endbell Image:		8	
J-Box cover	O-rings	🔽 J-Box					
HH cover	Glands	None			P		
Other missing pa	arts						

VEST TENNESSE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



## **Mechanical Inspection (Continued)**

Air Gap Meaurements (N/A on Single Pie	Does Air Gap Meet Customer or EASA spec(<10% variation)?	
DE @ 0	ODE @ 0	_
DE @ 90	ODE @ 90	
DE @ 180	ODE @ 180	
DE @ 270	ODE @ 270	


## **AC Electrical Inspection**

Number of leads:	9	Terminal Markings:					
Length of leads:	14 1/2 in	REF: NEMA Stds. MG 1-2009, Rev. 1-2010, 2.41-Terminal Markings Identified By Color:					
Size of leads:		1-Blue 2-White 3-Orange	5-Black 6-No color assigned 7-No color assigned	P1-No color assigned P2-Brown			
Lead condition:	Good 4-Yellow		8-Red				
Lug type:	NA	Connections As R	eceived:				
Lug Condition:	_		Terminal	Lugs			
Lug size:							
Lug Attachment:	_						

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



#### **AC Electrical Inspection (Continued)**

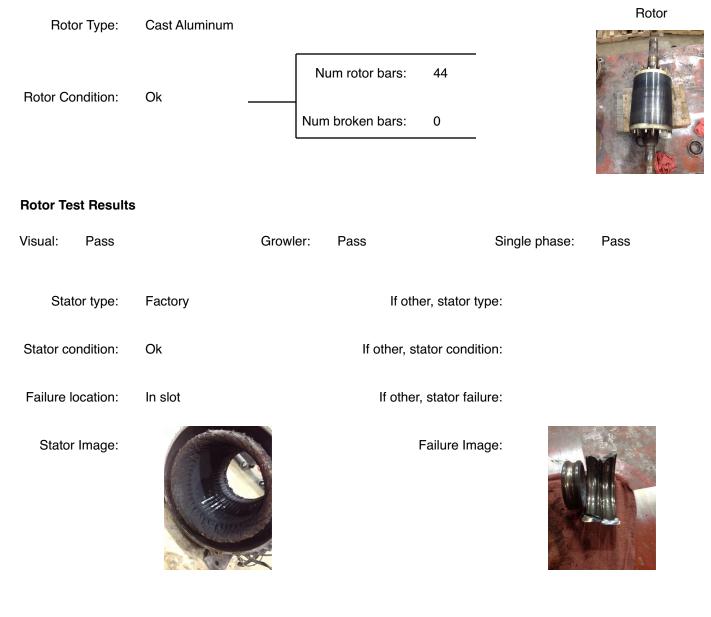

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



#### **AC Electrical Inspection (Continued)**

Winding color:	Dull black	Winding	g image \	Winding Therma	al Protectior	n: No
Winding condition :	Solid	(	2			
Winding Thermal Protection DE:	_					
Winding Thermal Protection ODE:	_		No. 100			
Stator test results:	Rewind					
Megs incoming: G	iood	Surge incoming:	Good	Hi-pot ir	ncoming:	Good
Winding Resistance I	ncoming					
Pha	ses A to B	Phases B to C	Phases	C to A	Resistive	imbalance
Incoming 0.0	0	0.00	0.00			
Leads/jump If other, leads/jump			Lead	jumper Image.		
Mechanical Ins	-	te correct fasteners.				
Shaft Cor	dition: Good		Bearings	Retainer: N	lo	

Bearing DE Size:

Bearing ODE Size:

6314

6210

Type of grounding device:

Shaft runout(TIR-Inbound):

Retainer condition:

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



# **Mechanical Inspection (Continued)**

Seals DE condition :	None	Brg. Seats DE:	Good
Seals DE type:	N/A	If DE undersized, amt.:	
Seals DE size:		Brg. Seats ODE:	Good
Seals DE (inbound) condition :		If ODE undersized, amt.:	
Seals ODE condition :	None	Shaft damage:	ОК
Seals ODE type:	N/A		
Seals ODE size:		Bushings/sleeves DE:	Ok
Seals ODE (inbound) condition :		Bushings/sleeves ODE:	Ok
Endbell fits/damage:	Bad	Foot/Flange condition:	Ok
Endbell DE size:	5.9078	Foot flatness:	Pass
Endbell DE insulated?:	_		stomer or EASA spec(<10%
Endbell ODE size:	3.5448	variation)?	
Endbell ODE insulated?:	_		

VEST TENNESSE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301



#### Conclusion

**Component Failure** 

**Cause of Failure** 

Comments

DE bearing shows signs of frosting, ODE bearing shows signs of extensive wear, ODE bearing fit on shaft is worn, DE and ODE bearing fits in the end bells are over sized, fan is broke, the J-box is missing, and the windings are blown. Recommend reconditioning, new bearings, aegis ring, machine work on DE and ODE end bells, machine work on ODE bearing fit of the shaft, new fan, new J-box, and rewind.

Service Tech name: Chris Wiley

Service Tech signature:

Chris Ully

WEST TENNESSEE 7030 Ryburn Drive Millington, TN 38053 Phone 901-873-5300 Fax 901-873-5301