


Report Title 2022 PDMA Motor MCE Test Report
Submitted By Administrator
Create Date 08/12/22 11:51 AM
Asset Name Whiter Water Loop Pump #1
Description USG Greenville, MS



Date: 06/25/22 11:47 AM Dated Test Event

Test Date	06/25/22
Test Time	11:47 AM
Test Location	Not Assigned
Tester Serial	5095
MTap ID	
	Baseline
Frequency	1200
Charge Time	600
Voltage	1000
Motor Temp	32
Measured Mohm	118.36
Corrected Mohm	68.00
pF Ph 1 to Ground	38700
ohm Ph 1 to 2	0.09290
ohm Ph 2 to 3	0.09300
ohm Ph 3 to 1	0.09300
mH Ph 1 to 2	6.951
mH Ph 2 to 3	6.740
mH Ph 3 to 1	7.436
Average Inductance	7.042
% Res. Imbalance	0.07
% Ind. Imbalance	5.59

Date: 06/25/22 11:47 AM Test: Polarization Index Test

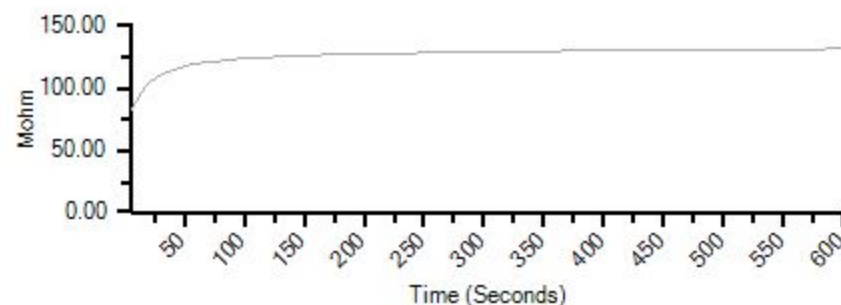

Date: 06/25/22 11:47 AM Dated Test Event

Test Date	06/25/22
Test Time	11:47 AM
Test Location	Not Assigned
Tester Serial	5095
MTap ID	
	Baseline
Voltage	1000
Duration	600
D/A Ratio	1.077
Polar. Index	1.099

Remarks: This is baseline data for this motor. Data looks acceptable at this time.